



### 125mm Mixflo Slow speed

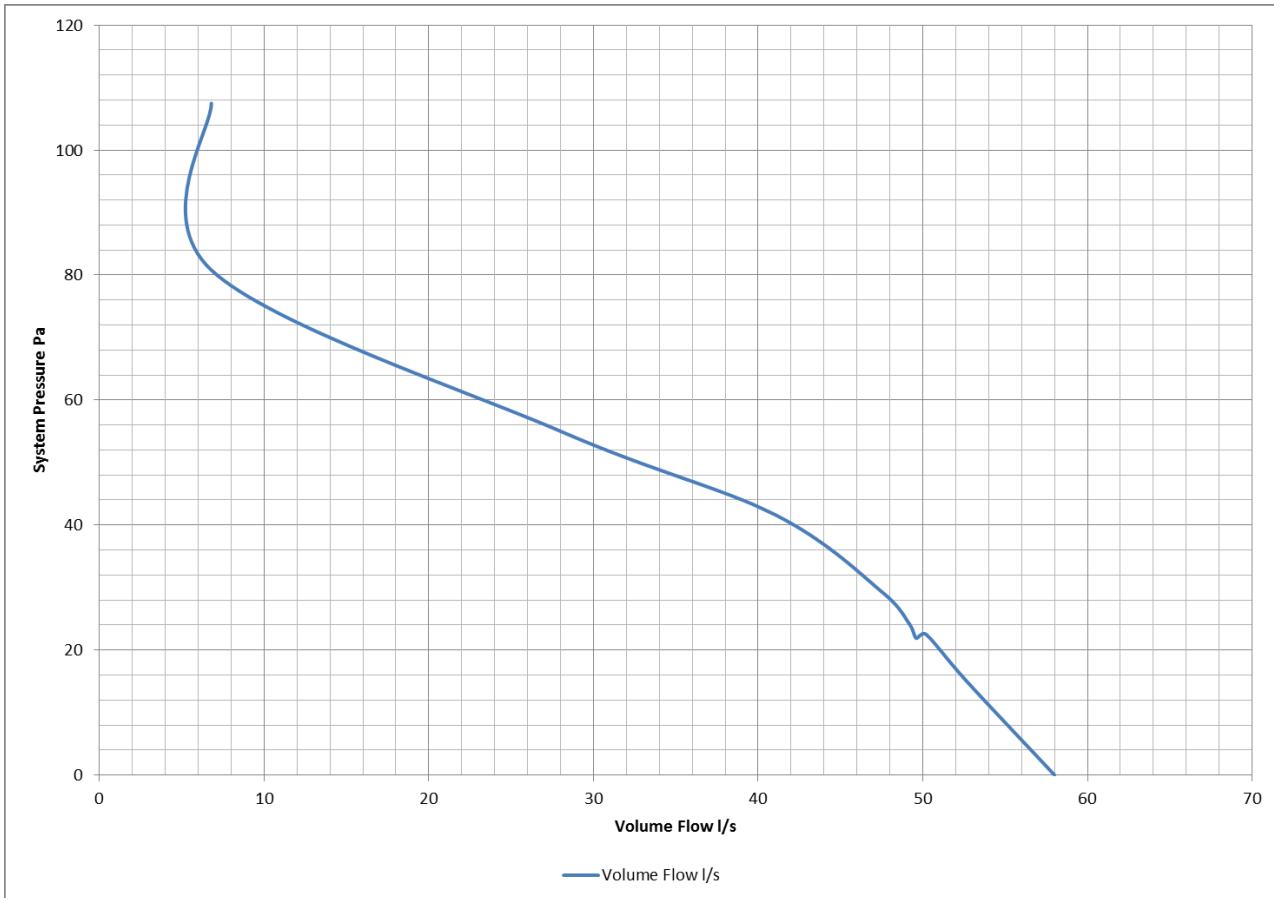

Volume Flow $\text{m}^3/\text{s}$	0.058	0.053	0.05	0.05	0.049	0.048	0.041	0.028	0.007	0.007				
Volume Flow $\text{m}^3/\text{h}$	208.6	189.8	180.7	178.6	177.1	171.8	147.6	101.3	24.6	24.6				
Volume Flow $\text{l/s}$	58	52.7	50.2	49.6	49.2	47.7	41	28.1	6.8	6.8				
Volume Flow $\text{ft}^3/\text{min}$	122.8	111.7	106.3	105.1	104.2	101.1	86.9	59.6	14.5	14.5				
Inlet Pressure(dp Pa)	40.4	33.5	30.4	29.7	29.2	27.5	20.4	9.7	0.6	-3				
Chamber Pressure (ps3 Pa)	0	14.9	22.5	21.9	24.1	28.9	41.7	54.9	80.8	107.5				
Duct Pressure (ps4 Pa)														
Ambient Temperature ( $^\circ\text{C}$ )	20.3	20.3	20.3	20.5	20.5	20.5	20.3	20.3	20.3	20.3				
Chamber Temperature ( $^\circ\text{C}$ )	20.8	20.8	20.8	20.8	20.9	20.9	20.9	20.9	20.9	20.9				
Speed (R P M)	3970	3970	3967	3969	3969	3966	3970	3972	3968	3971				
Power 'P1' (W)	22.2	22	21.9	21.7	21.7	21.6	21.3	20.1	19.4	19.6				
Power 'P2' (W)														
Current 'I1' (A)	0.1	0.099	0.099	0.098	0.098	0.098	0.097	0.092	0.088	0.089				
Current 'I2' (A)														
Current 'I3' (A)														

Test Date *	22/11/2012
Lab Reference No *	5555

### 125mm Mixflo Fast speed

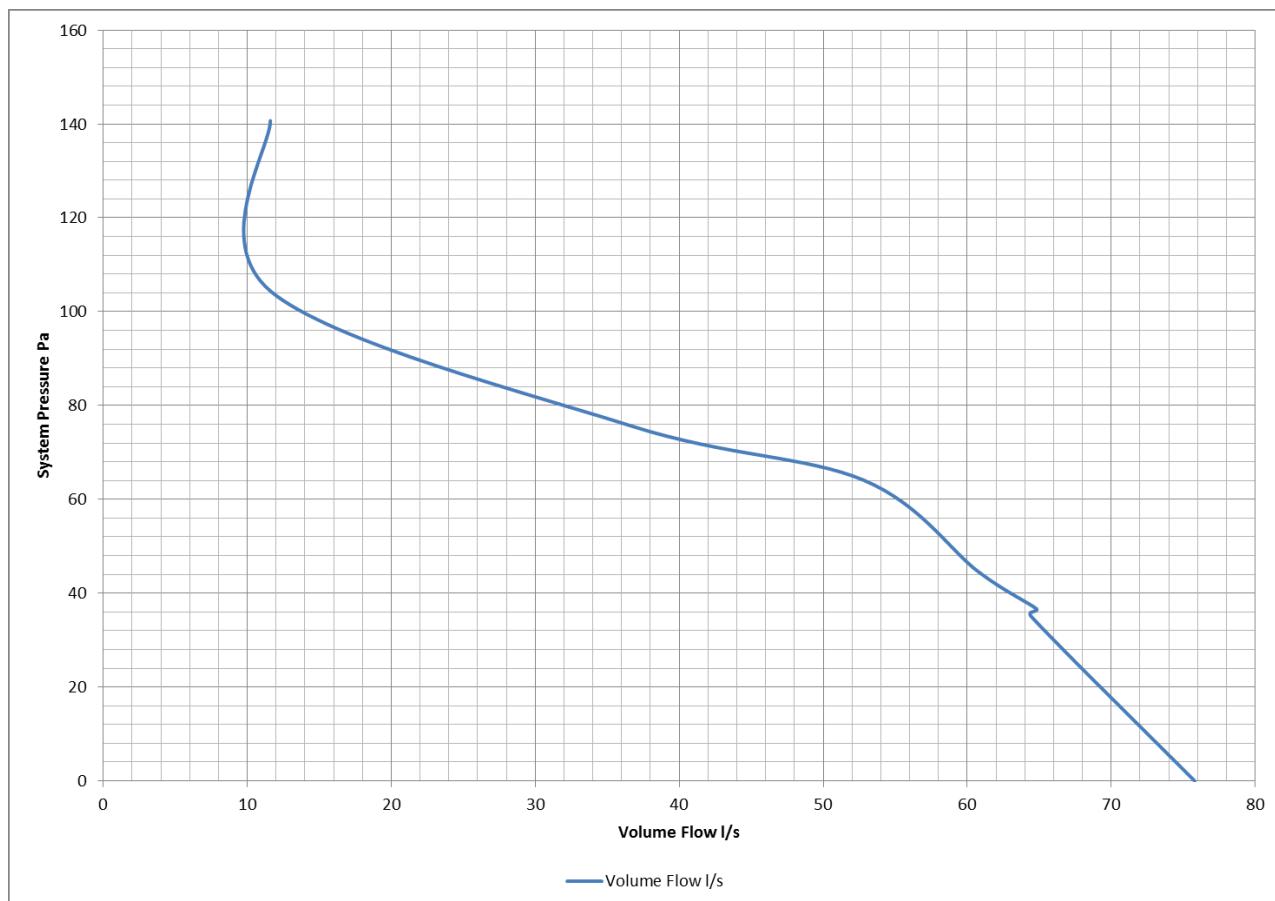

Volume Flow m³/s	0.076	0.067	0.064	0.064	0.065	0.061	0.053	0.037	0.012	0.012			
Volume Flow m³/h	272.8	242.7	231.9	231.9	233.3	218.8	190	131.7	41.8	41.8			
Volume Flow l/s	75.8	67.4	64.4	64.4	64.8	60.8	52.8	36.6	11.6	11.6			
Volume Flow ft³/min	160.6	142.9	136.5	136.5	137.3	128.8	111.8	77.5	24.6	24.6			
Inlet Pressure(dp Pa)	68.6	54.5	49.8	49.8	50.4	44.4	33.6	16.3	1.7	-2.8			
Chamber Pressure (ps3 Pa)	0	25.7	35.2	35.9	36.7	44.5	64.1	75.7	104.4	140.7			
Duct Pressure (ps4 Pa)													
Ambient Temperature (°C)	20.5	20.2	20.2	20.2	20.2	20.2	20.2	20.3	20.3	20.3			
Chamber Temperature (°C)	21.2	21.2	21	21	21	21	21	21	21	21			
Speed (R P M)	3971	3971	3962	3966	3967	3966	3969	3971	3968	3968			
Power 'P1' (W)	25.1	25	24.8	24.8	24.8	24.7	24.2	23.1	22	22.2			
Power 'P2' (W)													
Current 'I1' (A)	0.106	0.106	0.105	0.105	0.105	0.105	0.103	0.098	0.093	0.094			
Current 'I2' (A)													
Current 'I3' (A)													

Test Date *	22/11/2012
Lab Reference No *	5555